


CWP PUMP STATION SYSTEM (SINGLE PUMP AND SWITCH)



BR = BROWN
BU = BLUE
GN/YE = GREEN/YELLOW

EARTH NEUTRAL LIVE
MAINS SUPPLY 230V 50Hz

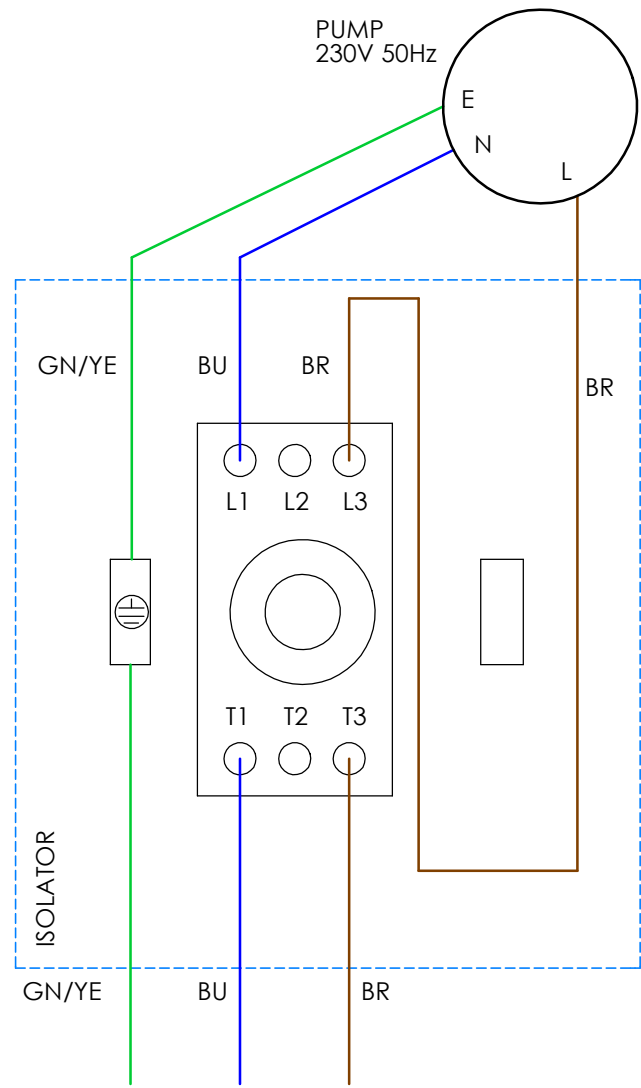

SEWAGE PUMP
GRUNDFOS UNILIFT
AP50B.50.08.A1.V
230V 50Hz
5.37 Amp



ISOLATOR
LOVATO GAZ016
16 Amp

HEALTH AND SAFETY AT WORK ACT 1974
To ensure that the equipment described is safe both for personnel and property, it should be installed, commissioned and maintained by or under the supervision of qualified persons. Regard should be taken of IEE wiring regulations, codes of practice, statutory requirements and any specific instructions issued by the supplier of these drawings.
EARTHING: All equipment must be earth bonded in accordance with the latest IEE wiring regulations.

Please check with Kingspan Environmental that this drawing is the latest issue				
Issue	Date	Drawn by	Approved by	Description
01	19/06/19	J.Belovic		Initial Release

Material :	Tolerance :
Finish :	Thickness :
Weight : Kgs	Surface Area :

Drawing : DS1356B Page 1 of 1
Electrical Diagram CWP Pump Chambers

All dimensions in mm
Scale: Not to scale

Clearwater reserve the right to alter the details of this drawing without prior notice.
This drawing is copyright and may not be reproduced or used without the written permission of Clearwater.